



Counterflow plate heat recovery exchanger



Enthalpy counterflow heat recovery exchanger



## BASIC FEATURES

**ALFA 95 RTU** – heat recovery ventilation roof top unit designed for commercial and retail constructions such as **offices buildings, hotels, shops and restaurants, leisure centres, public premises**, etc.

- **1 size** with nominal airflow **4900m<sup>3</sup>/h** @250Pa
- **SPI 2,0** kW/(m<sup>3</sup>/h) at nominal airflow
- Counterflow desk-plate heat exchanger – **aluminium** or **enthalpy**
- **AirGENIO control system** integrated
- **Rain protection** included in delivery
- **Roof curb** (insert) to facilitate the installation
- Ecodesign directive 1253/2014 compliant


ALFA 95 RTU is a ventilation unit with frameless self-supporting construction designed for outdoor roof-top installation. Casing is made from double skin mineral wool insulation panels of 50mm thickness with powder coating in RAL9010 and RAL9005. Rain protection accessories are included in delivery – rain hoods for air intake and air exhaust and arched roof with smart drip edges. Highly recommended external accessory is an attenuating roof curb, which is designed to fit precisely to the unit, to ease up the installation and prevent a water leakage. The supply and extract of the unit is equipped with energy efficient centrifugal fans and air filters monitored by pressure transmitters (pre-filter - Coarse 65%, supply filter – ePM1 60%, extract filter – ePM10 50%).

The unit is fitted with counterflow desk-plate heat recovery system – aluminium or enthalpy core, which are EUROVENT certified. The heat recovery system has an integrated modulating by-pass damper.

Complete control system AirGENIO is factory fitted and wired in the unit together with the touch screen control panel and communication UTP cable.

ALFA 95 RTU heat recovery unit is designed to be operated at an outdoor environment and at an ambient temperature in the range from -20°C up to +60°C, for transporting standard atmospheric air that is free of dust, grease, chemical emissions and other impurities. The unit, when installed in the ducting system has an IP rating of IP43. The design of the ventilation project must be **always designed by a qualified HVAC designer, engineer or architect**.


Operational diagram

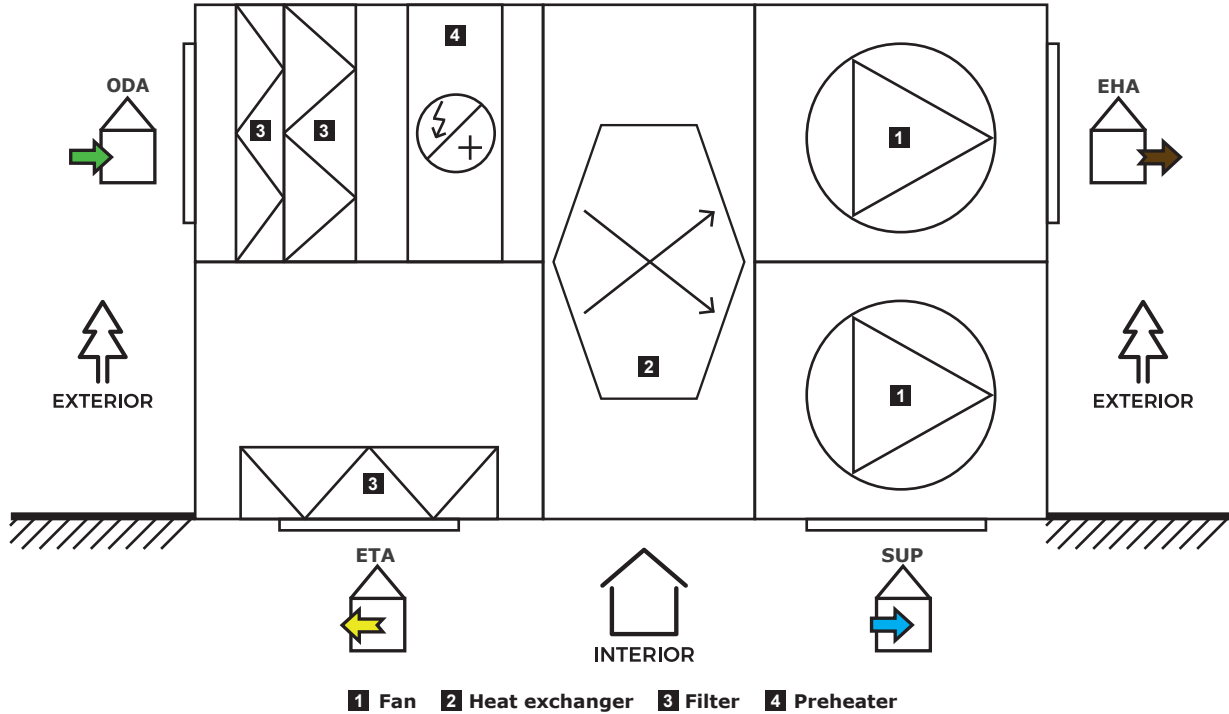

PRIMARY PARAMETERS

HRRU1-500 CB

SFP = Unit Power input (kW/m<sup>3</sup>/s)

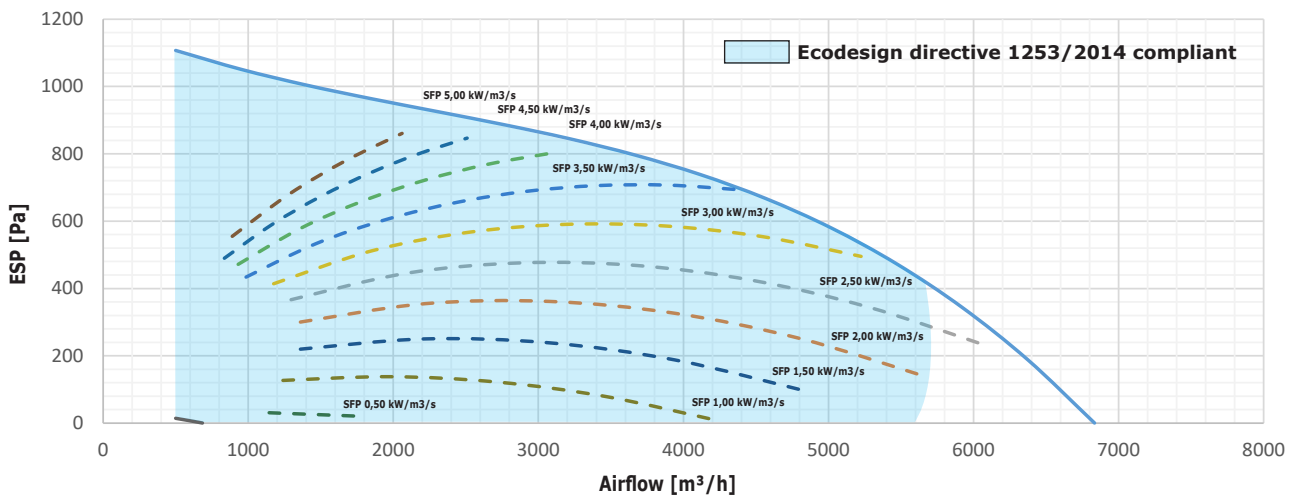


**PRIMARY PARAMETERS**




**HRRU1-500 EB**

SFP = Unit Power input (kW/m<sup>3</sup>/s)

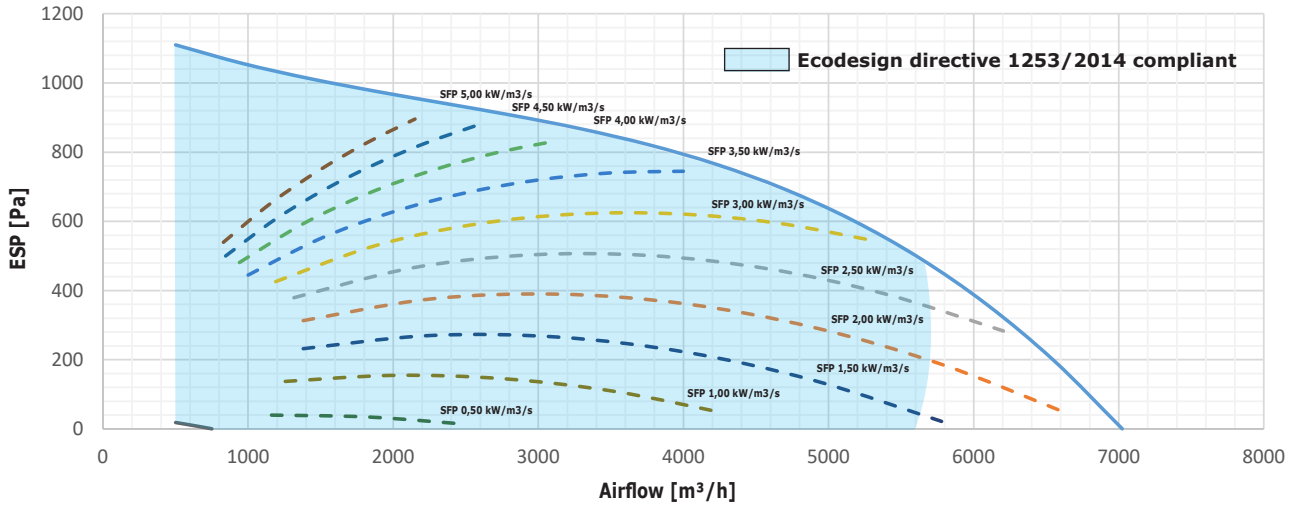

**Heat recovery efficiency:**


**EN308-W1 (T-out 5°C/72%RH, T-in 25°C/28%RH)**

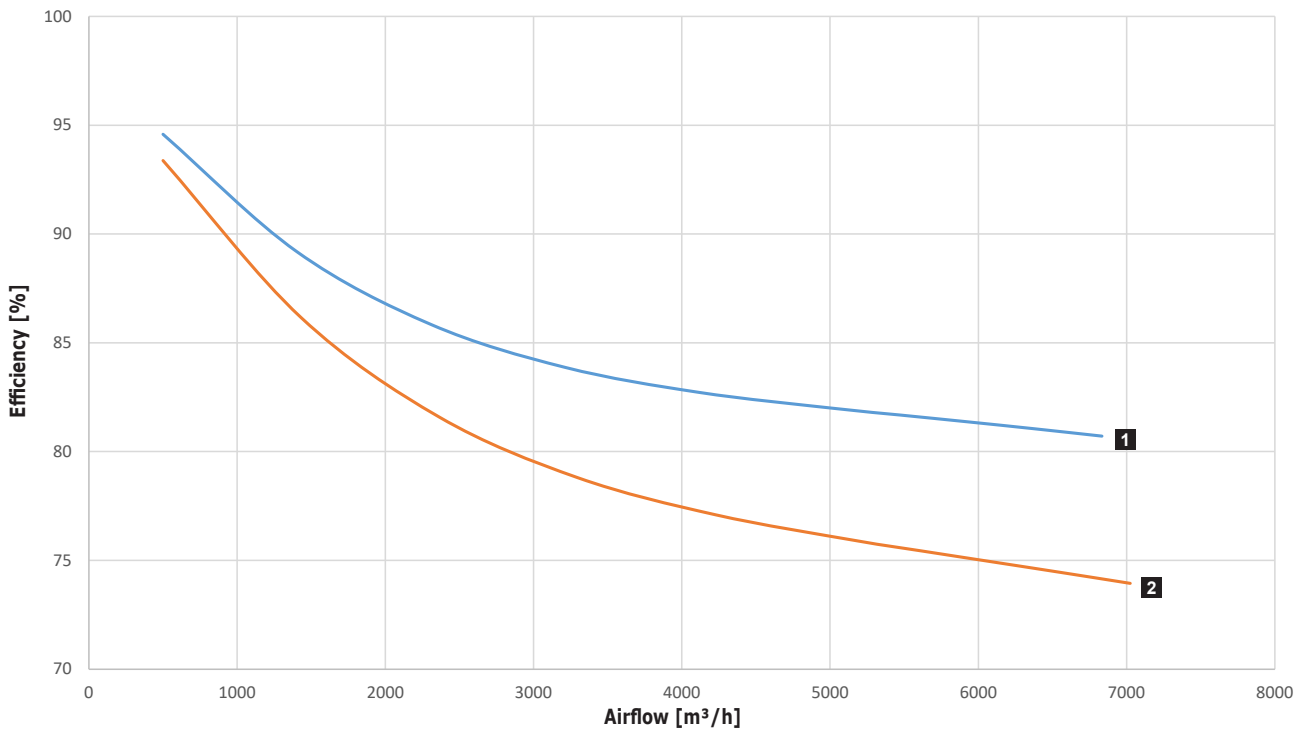

**1** HRRU1-500 CB **2** HRRU1-500 EB



**Humidity efficiency:**  
**Enthalpy exchanger - EN308-W2 (T-out 5°C/72%RH, T-in 25°C/51%RH)**

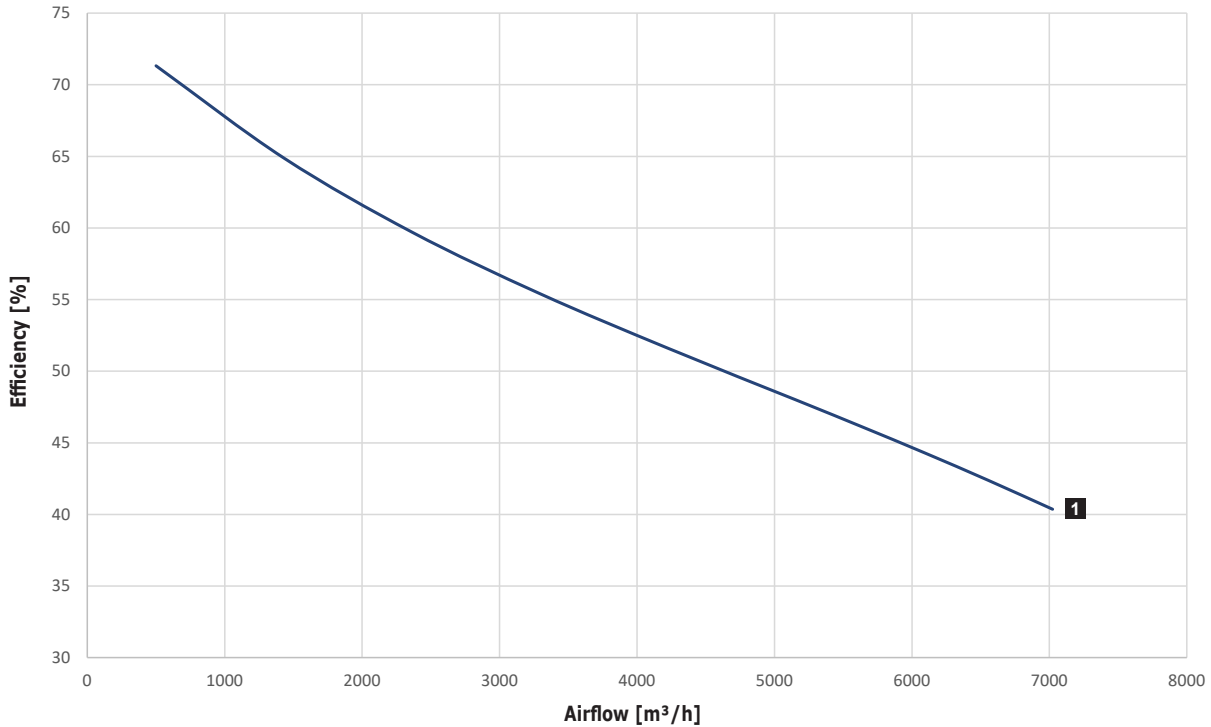

**1 HRRU1-500 EB**



**Basic technical parameters of the heat recovery units:**

Model	Phase [pcs]	Voltage [V]	Frequency [Hz]	Rated input [kW]	Total current [A]
HRRU1-500	3	400	50/60	21,4	33,5


**Noise specifications (casing radiated):**

Type	Airflow [m³/h]	Pressure [Pa]	Sound power level per frequency band L <sub>w</sub> (dB(A))								Overall	
			63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	L <sub>w</sub> [dB]	L <sub>pA</sub> [dB] at 3m
HRRU1-500	1000	300	86,0	79,1	74,0	70,2	65,4	58,8	50,1	45,0	<b>72,1</b>	<b>48,9</b>
	3000	300	85,3	82,2	73,7	71,5	69,2	66,5	59,8	54,9	<b>74,9</b>	<b>51,7</b>
	5000	300	79,6	88,6	76,9	77,8	76,4	72,9	67,9	64,1	<b>81,2</b>	<b>58,0</b>

Branch	Airflow [m³/h]	Pressure [Pa]	Sound power level per frequency band								Overall
			63Hz	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	8kHz	L <sub>WA</sub> [dB]
SUP	5000	300	80,0	84,3	74,5	72,6	69,9	67,1	62,1	60,1	<b>75,9</b>
ETA			78,3	76,2	68,8	65,1	60,1	54,9	48,0	40,0	<b>67,2</b>



**DIMENSIONS**

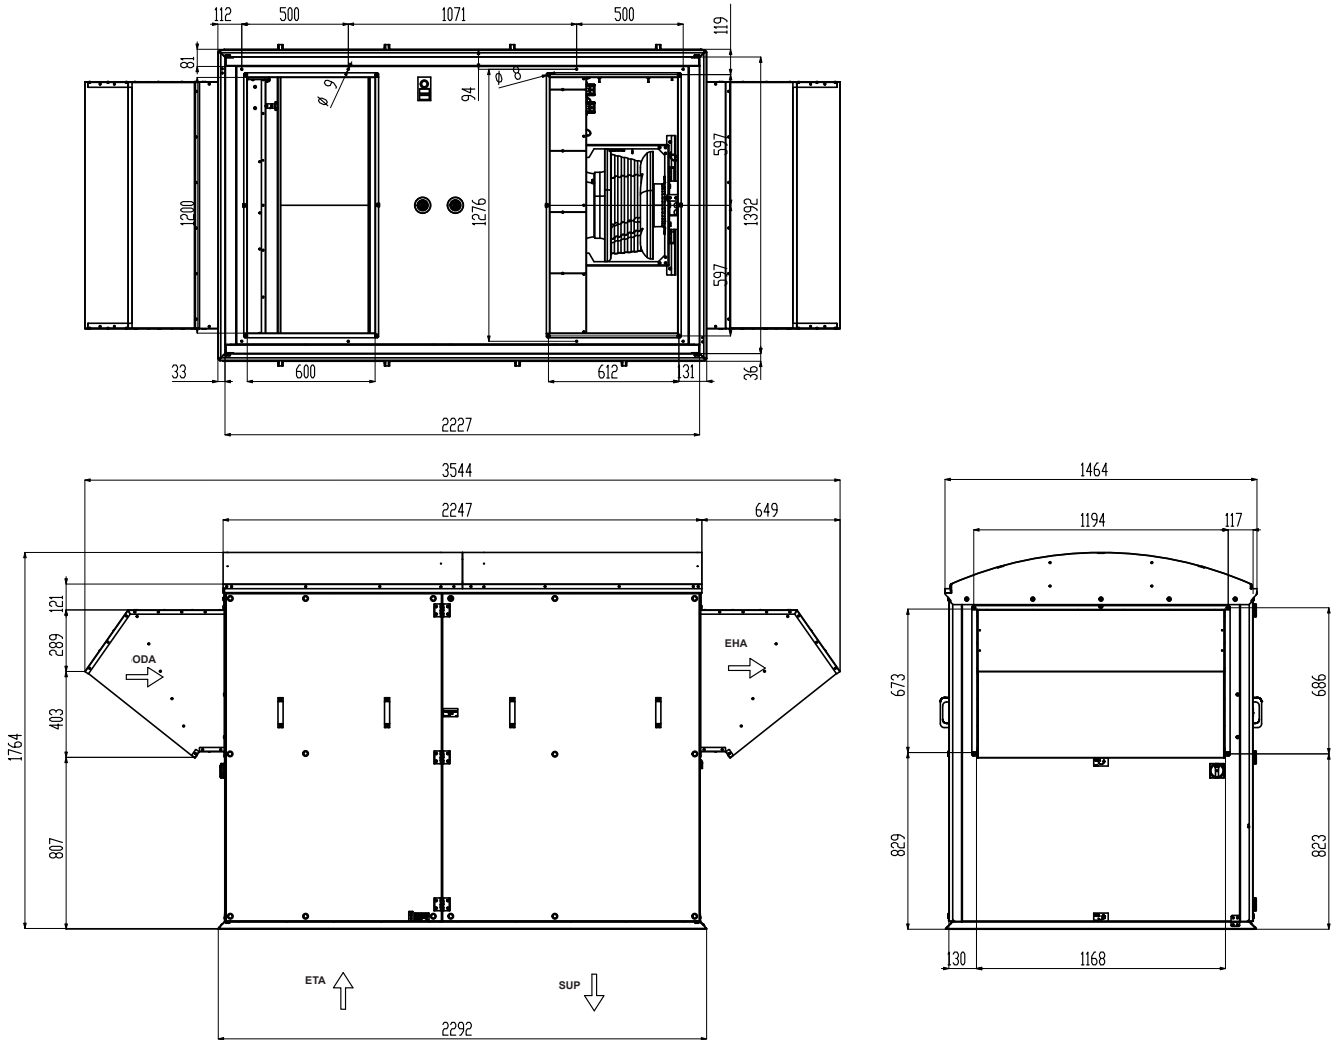





### INSTALLATION AND ASSEMBLY

The ventilation unit must be installed according to the pictures (see below).

The unit must be installed in such a way that the direction of the air blown corresponds to the direction of air circulation in the distribution system. The unit must be installed so as to give free access for maintenance, service or dismantling. This is to allow access to service doors and possibility to open them, access to the lid of the control panel, access to the lateral connections and access to the filter cover.

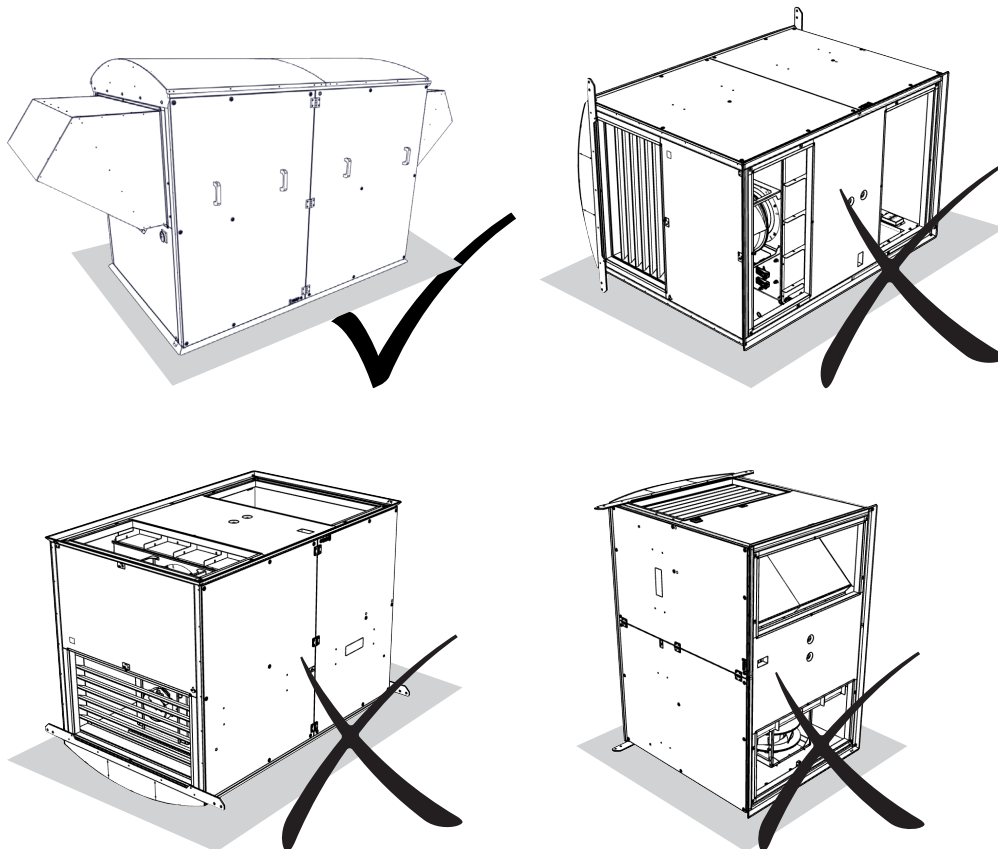

WIRING DIAGRAMS

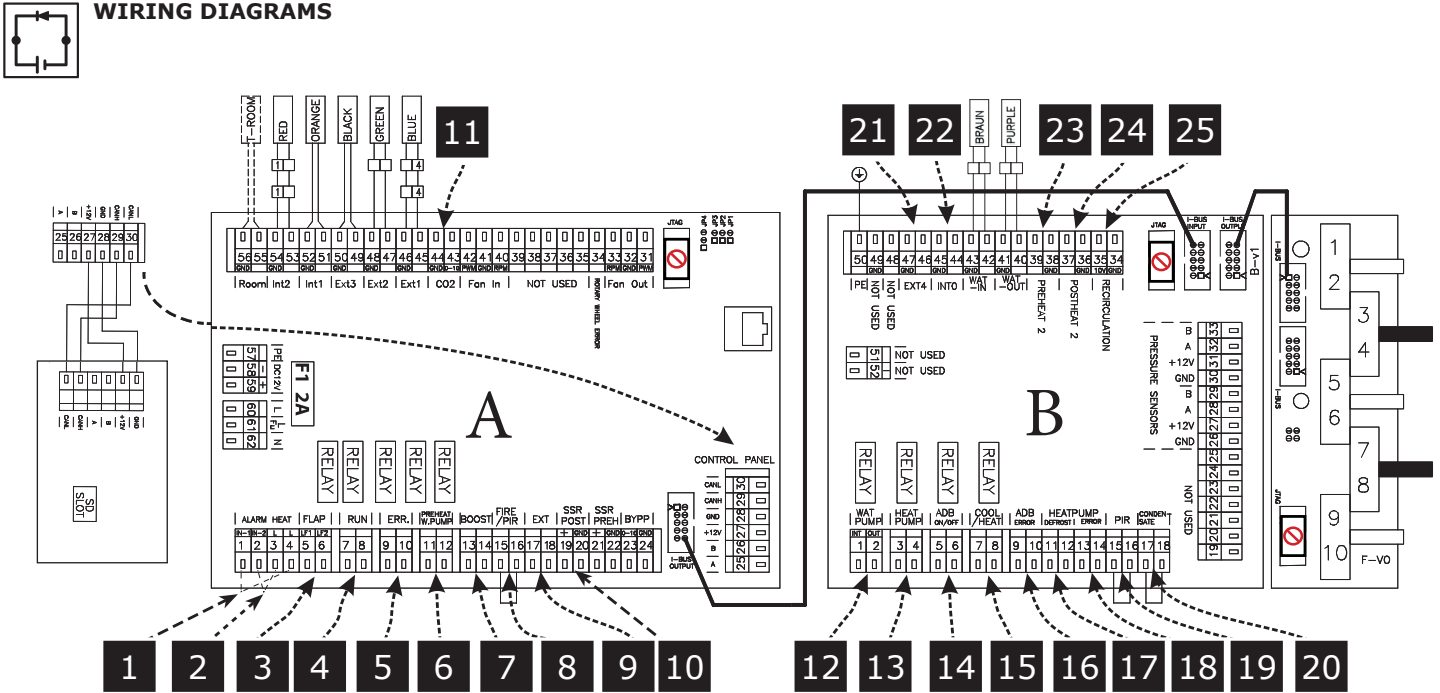

1.	A (1,4)	SAFETY THERMOSTAT POSTHEATING
2.	A (2,3)	SAFETY PREHEATING THERMOSTAT
3.	A (5-6)	LF1 - FLAP INLET (output L-open), LF2 - FLAP OUTLET ( output L-open)
4.	A (7-8)	RUN CONTACT (output - NO/NC settable)
5.	A (9-10)	ERROR CONTACT (output NO)
6.	A (11-12)	PREHEATER WATER PUMP (11 - Lint, 12 - Lout)
7.	A (13-14)	BOOST (input NO)
8.	A (15-16)	FIRE (input NC)
9.	A (17-18)	EXTERNAL CONTROL ON/OFF (input NC)
10.	A (19,20)	OUTPUT PERFORMANCE OF POSTHEATING (0-10V OR PWM)
11.	A (43-44)	AQS SENSOR 0-10V (input)
12.	B (1-2)	WATER PUMP (1 - Lint, 2 - Lout)
13.	B (3-4)	HEAT PUMP CONTROL settable (output - ON/OFF)
14.	B (5-6)	ADIABATIC MODULE (output - ON/OFF)
15.	B (7-8)	COOL / HEAT settable (CO = NC/NO - DX = output settable)
16.	B (9-10)	ADIABATIC MODULE ERROR (input NO)
17.	B (11-12)	HEAT PUMP DEFROST settable (input NC/NO)
18.	B (13-14)	HEAT PUMP ERROR settable (input NC/NO)
19.	B (15-16)	PIR (input NC)
20.	B (17-18)	CONDENSATE OVERFLOW (input NC)
21.	B (46-47)	EXTERNAL TEMPERATURE SENSOR (external postheater - input)
22.	B (44-45)	EXTERNAL TEMPERATURE SENSOR (adiabatic module / recirc. chamber - input)
23.	B (38-39)	EXTERNAL PREHEATER (output 0-10V)
24.	B (36-37)	EXTERNAL POSTHEATER (output 0-10V)
25.	B (34-35)	RECIRCULATION CHAMBER (output 0-10V)



## CONTROL

### AirGENIO SUPERIOR - Main control functions

- Touch-screen control panel for easy control and complete overview of device operational status (recommended connecting data cable to control panel is UTP cable and it should not exceed 50m length).
- Manual stepless fans control (PWM)
- CAV, VAV or DCV ventilation in automatic mode
- BOOST mode - intensive airflow for a pre-set time period
- Freecooling mode - night ventilation (cooling)
- Occupancy mode - reducing ventilation intensity according to the PIR sensor
- FIRE protection mode with settable logic
- Thermal wheel control (temperature control: freecooling, antifreeze protection)
- Integrated timer (day, week, year)
- Optional connection of sensors: CO<sub>2</sub>, RH, VOC (0-10)
- Clogged filter indication by pressure sensors
- Stepless post-heating control
- Electric coil control (PWM) and LPHW coil control (0-10 V)
- Change-over control with automatic detection of the heating / cooling (0-10 V)
- Wide choice of different ways for DX coil control\*
- Possible control of external pre-heater and post-heater
- Offset fan adjustment (over-pressure / underpressure)
- BMS control via Modbus RTU / TCP or BACnet
- Remote control via smart device



### \*AirGENIO SUPERIOR control system allows a different ways of DX coil control

- ON-OFF
- 0-10 V
- 0-10 V - 0-10 V signal control
- On/Off - On/Off switching
- Off/On - Off/On switching
- 0-10 V + On/Off - On/Off switching + 0-10 V signal control
- 0-10 V + Off/On - Off/On switching + 0-10 V signal control

With reverse control cycle (heating - cooling mode)

- 10-0 V + On/Off - On/Off switching + 0-10 V signal control cooling, heating 10-0 V
- 10-0 V Off/On - Off/On switching + 0-10 V signal control cooling, heating 10-0 V




### 2V Service software:

- Easy and quick commissioning from your computer
- Error log – error display and identification
- Easy service (device status loading/reset to backup setting)
- Fast FW update
- OFFLINE version

### AirGENIO CLOUD - Connections you can trust

2VV cloud service operated on secure cloud server.

- Control, monitoring and servicing
- Web communication interface with clear and structured layout
- Easy customization of settings
- History logs providing accurate and timely info
- Smart notifications and warning/error messages clearly displayed in overview dashboard
- Backup and restore settings

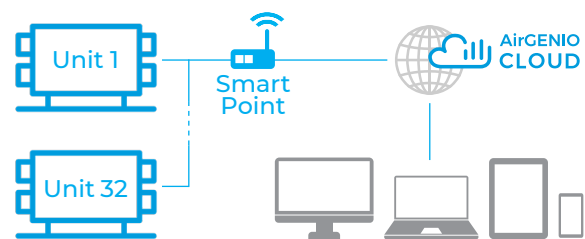





**ACCESSORIES**

**Filtration inserts**

Replacement filtration inserts of various filtration classes.






Unit type	Pre-filter type – Coarse 65%	Inlet filter type – ePM 1 60%	Extract filter type – ePM 10 50%
HRRU1-500	HRRU1-500X-FI-G4-0A0	HRRU1-500X-FI-F7-0A0	HRRU1-500X-FI-M5-0A0

**Roof insert**

**HRRU1-500-DI100-0A0**

The roof insert for installation of the unit to the roof opening.

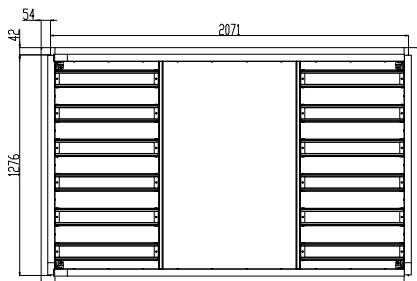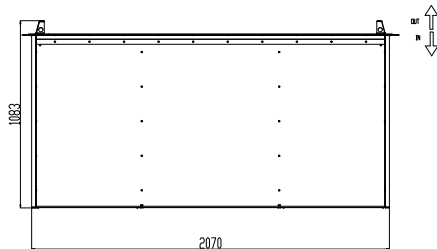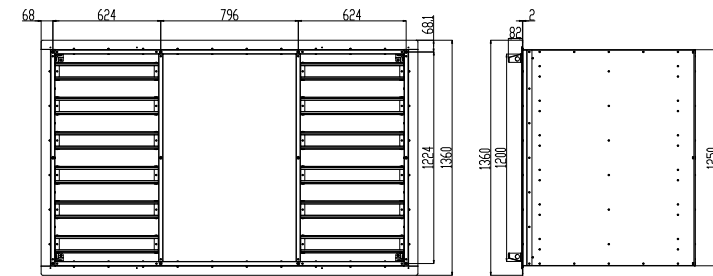



## ACCESSORIES

### Channel sensor CO<sub>2</sub> *CI-EE850-C3xx-FP*

The transmitter is ideally suited for duct mounting in the fields of building management and demand controlled ventilation. The elegant, compact housing enables easy installation directly at the ventilation duct using a mounting flange.



### Duct sensor of relative humidity *CI-LCN-FTK140VV*

Duct sensor for measuring relative humidity in air-conditioning systems.



### Spatial sensor CO<sub>2</sub> *CI-CO2-R*

Sensor combines CO<sub>2</sub>. The snap-in mounting concept stands for easy installation.



### Spatial sensor RH *CI-RH-R*

Capacitive relative humidity sensor with 0-10V analog and relay output.



### Signal combiner *CI-AQS-COMBI*

The signal combiner for AQS sensors uses 0-10V logic which you can connect up to 10 different sensors. The input signal with the highest voltage will be the signal that is on the output terminal.



### PIR sensor *CI-PS 1003*

Spatial infrared sensor for automatic ventilation based on presence of people in the ventilated area.

**Power supply of this sensor must be outsourced. Unit doesn't support this kind of power supply (15-24V DC).**



### AirGENIO CLOUD smart point *AirGENIO-SMART-POINT*

2V cloud service operated on secure cloud server



## KEY TO CODING

HRRU1-500 X X CB E 75 - E S0 S - 0A 0

